




A3.17

- A. REFER TO STRUCTURAL FOR ADDITIONAL WALL FRAMING INFORMATION, U.O.D. 1. ALL EXTERIOR WALLS TO BE 2x6 FRAMING U.O.D.
- B. SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION. **ALL DIMENSIONS ARE TO FRAMING FACE OF STUD. NOT FINISH WALL.**
- C. **ARCHITECTURAL PLANS DICTATE ACCESSIBILITY REQUIREMENTS.**
- D. REFER TO ENLARGED PLANS FOR ADDITIONAL NOTES & DIMENSIONS NOT SHOWN ON THIS SET OF DRAWINGS.
- E. SEE MECHANICAL, ELECTRICAL, CIVIL AND LANDSCAPE PANS FOR ADDITIONAL INFORMATION.
- F. FIRE BLOCKING SHALL BE PROVIDED:
 1. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES, AT THE CEILING AND FLOOR LEVELS @ 10' INTERVALS BOTH HORIZONTAL AND VERTICAL.
 2. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL & HORIZONTAL SPACES SUCH AS SOFFITS, DROP CEILINGS AND COVE CEILINGS.
 3. IN OPENINGS ABOVE VENTS, PIPES, DUCTS, CHIMNEYS, FIREPLACES & SIMILAR OPENINGS WHERE THERE IS A RISK OF FIRE AT CEILING & FLOOR LEVELS, WITH NON-COMBUSTIBLE MATERIALS.
 4. REFER TO DOOR AND WINDOW SCHEDULES FOR SAFETY GLAZING LOCATIONS.
- G. EVERY OPENING INTO AN ELEVATOR SHAFT ENCLOSURE SHALL BE PROTECTED BY A SELF-CLOSING OR AUTOMATIC CLOSING FIRE ASSEMBLY HAVING A 1-HOUR RATED FIRE PROTECTION RATING.
- H. PER CBC 1009.8 FIVE TWO-WAY COMMUNICATION SYSTEM COMPLYING WITH SECTIONS 1009.8.1 & 1009.8.2 SHALL BE PROVIDED AT THE LANDING SERVING THE BANK OF ELEVATOR ON EACH ACCESSIBLE FLOOR.
- I. REFER TO FINISHES AND FINISHES SCHEDULE FOR ADDITIONAL INFORMATION. OWNER TO APPROVE ALL FINISHES PRIOR TO INSTALLATION.
- J. REFER TO INTERIOR DESIGN FOR FINISHES. ALL PAINT FINISHES TO END ON AN INTERIOR CORNER.
- K. PROVIDE MOISTURE & MOLD RESISTANT DRYWALL IN ALL WET LOCATIONS.

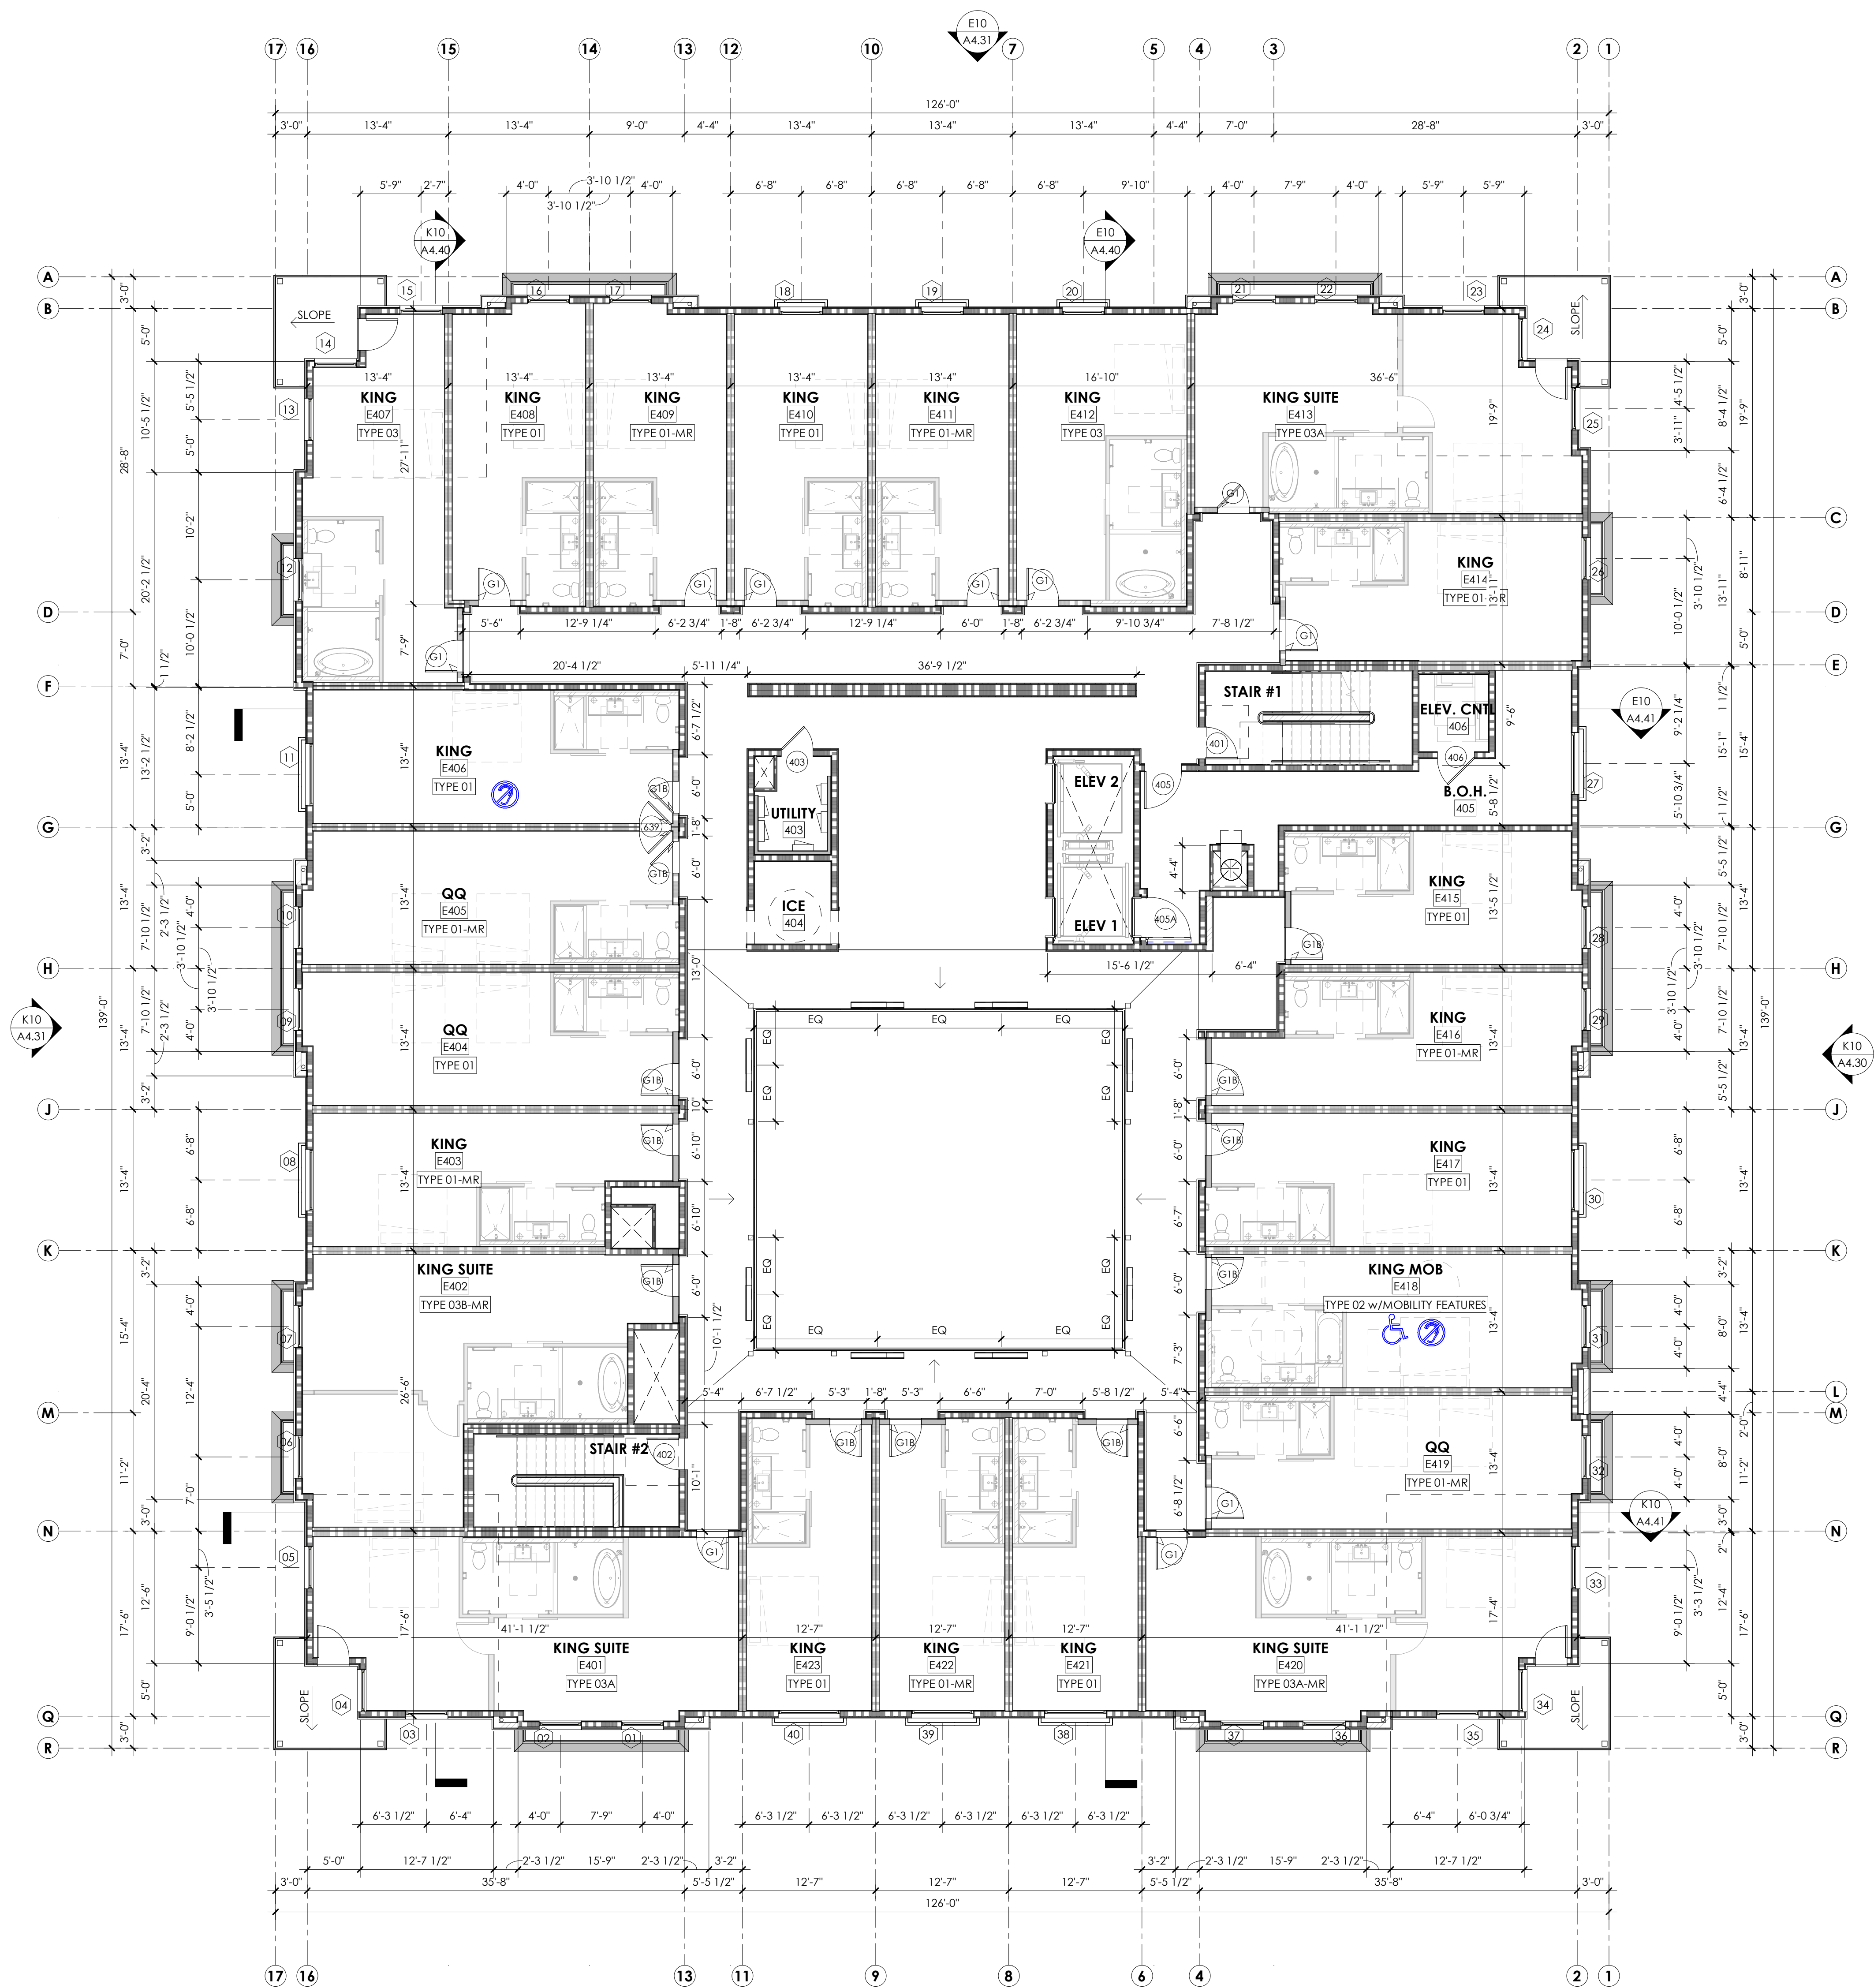

K12 **EAST BUILDING - FOURTH FLOOR PLAN**
1/8" = 1'-0"



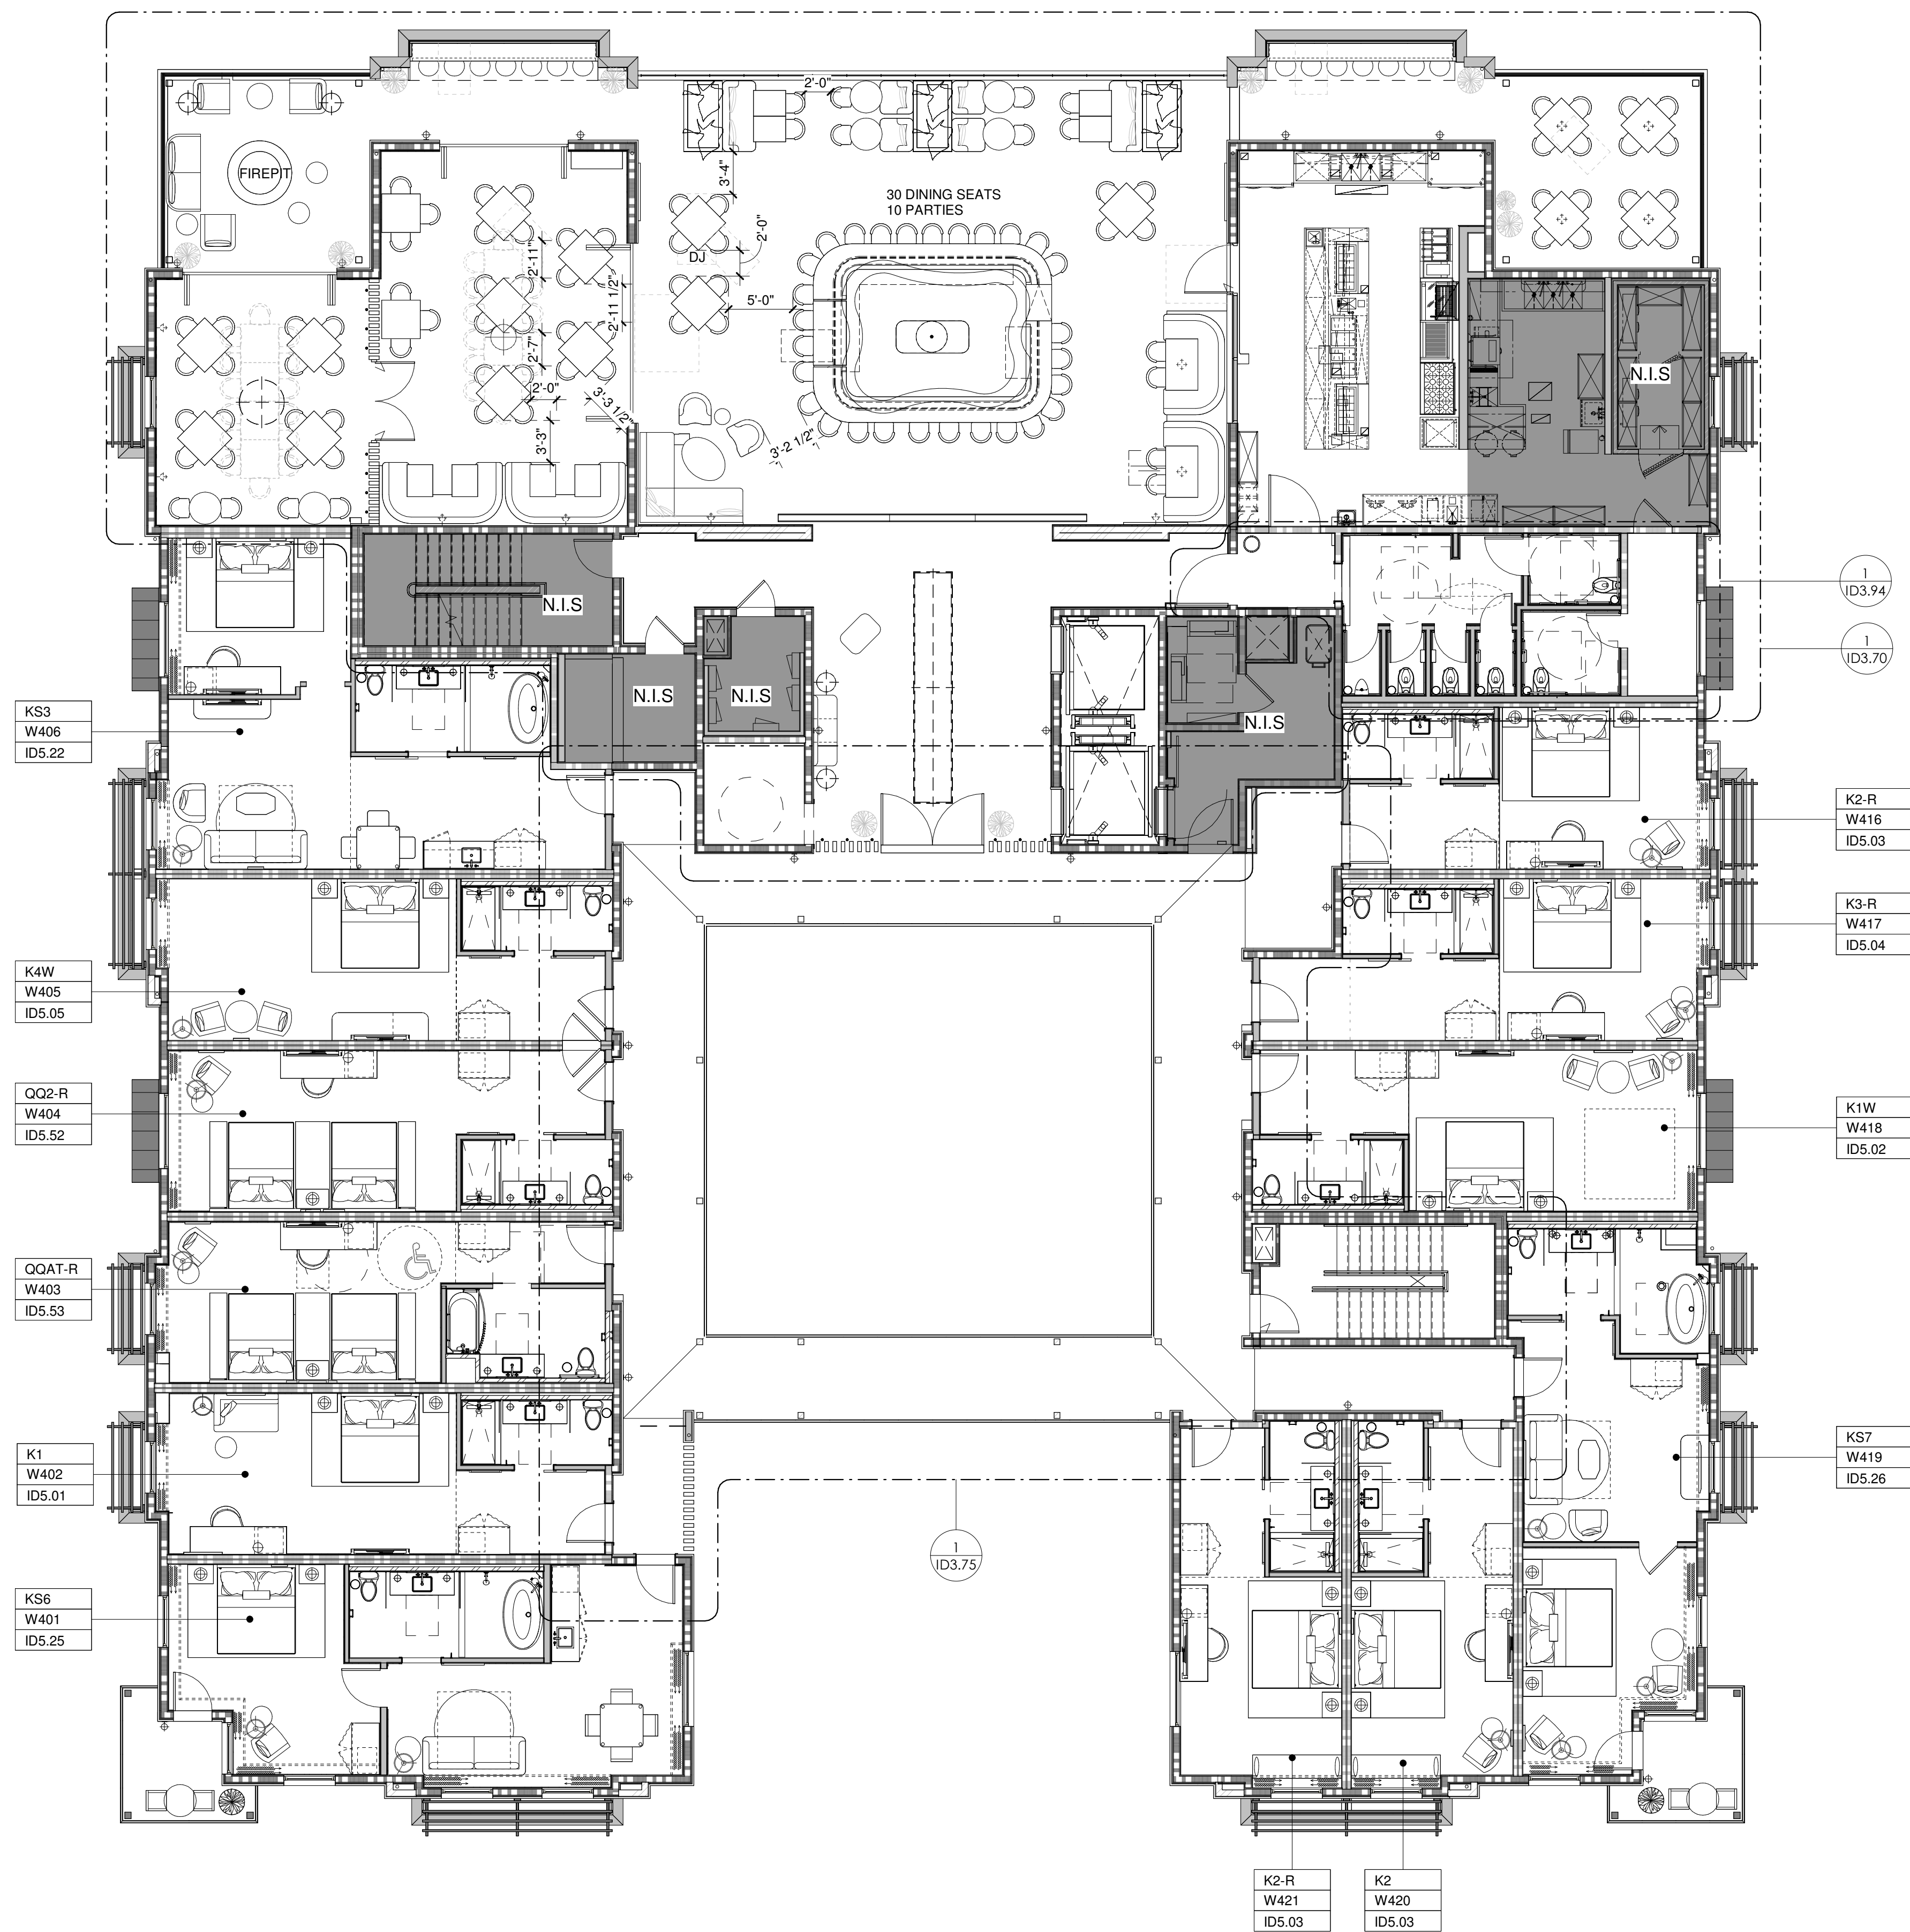**1 LEVEL 04 - WEST BUILDING KEY PLAN**
1/8" = 1'-0"